


UNPAVED AND FUTURE PAVED AREAS

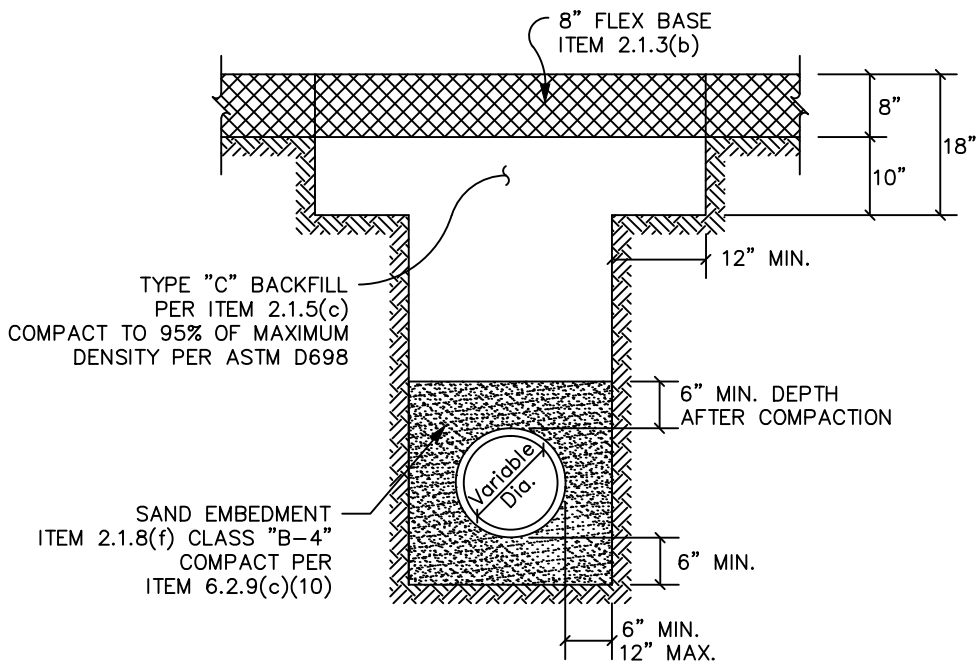

EXISTING FLEXBASE SURFACE

NOTES:

1. AT THE END OF EACH WORK DAY, ALL SPOILS SHALL BE REMOVED FROM THE TOWN R.O.W. UNLESS PRIOR WRITTEN PERMISSION IS OBTAINED FROM THE TOWN TO STORE SPOILS IN DESIGNATED SPOIL STORAGE AREAS THAT DO NOT OBSTRUCT AUTOMOBILE OR PEDESTRIAN TRAFFIC.
2. A MAXIMUM OF 300-FT OF OPEN TRENCH WILL BE ALLOWED AT ANY TIME, UNLESS APPROVED BY THE TOWN ENGINEER.
3. MINIMUM COVER SHALL BE 42-INCHES FOR 8" & 12" WATER LINES AND 60-INCHES FOR 16" & LARGER WATER LINES.
4. IF GROUND WATER IS ENCOUNTERED THE PIPE EMBEDMENT SHALL BE CRUSHED ROCK GRADE 4 PER ITEM 2.1.8 (a). IN SANDY SOILS THE CRUSHED ROCK EMBEDMENT SHALL BE WRAPPED IN A FILTER FABRIC.

