


EXISTING ASPHALT PAVEMENT

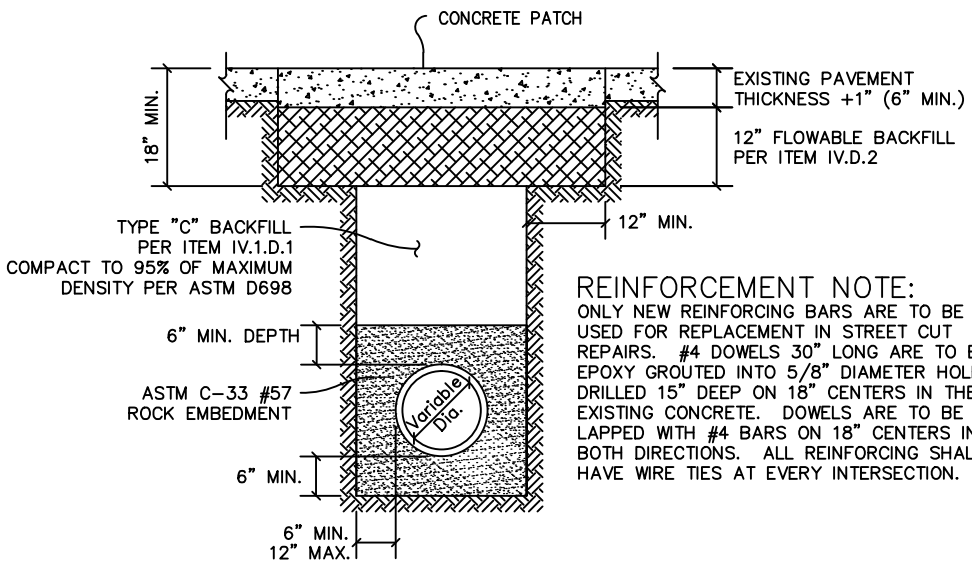

REINFORCEMENT NOTE:
 ONLY NEW REINFORCING BARS ARE TO BE USED FOR REPLACEMENT IN STREET CUT REPAIRS. #4 DOWELS 30" LONG ARE TO BE EPOXY GROUTED INTO 5/8" DIAMETER HOLES DRILLED 15" DEEP ON 18" CENTERS IN THE EXISTING CONCRETE. DOWELS ARE TO BE LAPPED WITH #4 BARS ON 18" CENTERS IN BOTH DIRECTIONS. ALL REINFORCING SHALL HAVE WIRE TIES AT EVERY INTERSECTION.

EXISTING CONCRETE PAVEMENT

NOTES:

1. AT THE END OF EACH WORK DAY, ALL SPOILS SHALL BE REMOVED FROM THE TOWN R.O.W. UNLESS PRIOR WRITTEN PERMISSION IS OBTAINED FROM THE TOWN TO STORE SPOILS IN DESIGNATED SPOIL STORAGE AREAS THAT DO NOT OBSTRUCT AUTOMOBILE OR PEDESTRIAN TRAFFIC.
2. ALL PAVEMENT SHALL BE REMOVED ALONG NEAT AND CLEAN SAW CUT LINES.
3. A MAXIMUM OF 300-FT OF OPEN TRENCH WILL BE ALLOWED AT ANY TIME, UNLESS APPROVED BY THE TOWN ENGINEER.
4. NATIVE MATERIALS ARE **NOT** ACCEPTABLE FOR USE IN FLOWABLE BACKFILL MIX.
5. IN SANDY SOILS A CRUSHED ROCK EMBEDMENT GRADE 8 PER ITEM IV.1.B IN LIEU OF ASTM C-33 #57 AND SHALL BE WRAPPED IN A FILTER FABRIC.

