
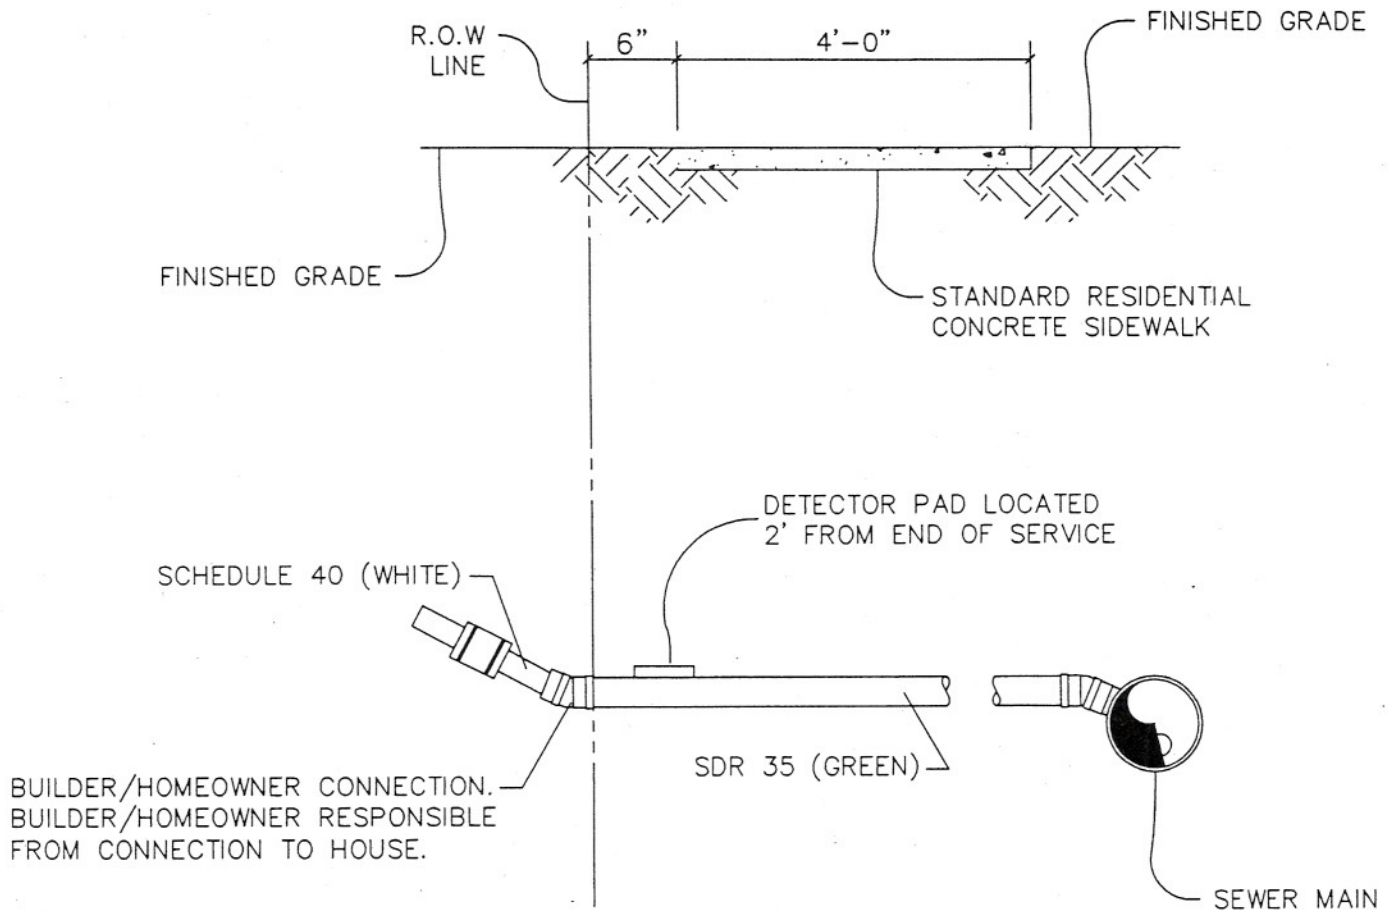


**NOTES:**

1. METER BOX SHALL BE BROOKS 36H PRECAST CONCRETE OR APPROVED EQUAL WITH A PRECAST CONCRETE COVER AND A CAST IRON READER LID FOR 3/4" AND 1" METERS. METER BOX SHALL BE BROOKS 38 CONCRETE PULLBOX OR APPROVED EQUAL WITH 38-T CAST IRON COVER FOR 2" METERS.
2. INSTALL ANGLE STOP FOR 3/4" THRU 2" METERS (AWWA C800) WITH LOCKING MECHANISM AND COMPRESSION FITTINGS. FOR LARGER THAN 2" SERVICE, INSTALL RESILIENT SEAT GATE VALVE (AWWA C509).
3. METER BOX SHALL BE A MINIMUM OF 6" BEHIND THE BACK OF CURB WITH THE WATER SERVICE NOT LESS THAN 8" BELOW GRADE.
4. SERVICES ALONG ROADWAYS WITHOUT CURB AND GUTTER SHALL BE LOCATED A MINIMUM OF 18" BELOW THE DITCH FLOWLINE.
5. SERVICE LINES CROSSING UNDER THE ROADWAY SHALL BE LOCATED A MINIMUM OF 24" BELOW THE BOTTOM OF THE PAVEMENT.
6. SERVICE SADDLES SHALL BE DOUBLE STRAP BRASS WITH BRASS BODY OR DOUBLE BOLT WIDE STRAP STAINLESS STEEL WITH STAINLESS STEEL BODY.
7. METER AND RESIDENTIAL SERVICE LINE SHALL BE INSTALLED BY PLUMBER WHEN THE HOUSE IS CONSTRUCTED.

	WATER SYSTEM CONSTRUCTION DETAILS	DATE: 07/22/02
	WATER SERVICE ASSEMBLY 3/4" - 2"	SHEET 1 OF 1
		SHEET: W-5



**NOTES:**

1. THE CONNECTION PLACED ONTO THE TOWN'S SERVICE LINE IS MAINTAINED BY THE HOMEOWNER. THIS CONNECTION WILL BE MADE WITHIN THE R.O.W. OR EASEMENT AS SHOWN ON DEVELOPMENT PLAT. THE TOWN IS NOT RESPONSIBLE FOR ANY CONNECTION OUTSIDE OF THR R.O.W. OR EASEMENT.
2. THE MAINTENANCE OF SIDEWALKS IS A HOMEOWNER ITEM. TOWN ORDINANCE ESTABLISHES HOMEOWNER RESPONSIBILITY. SIDEWALKS ARE CONSTRUCTED AS PART OF THE HOME ALONG WITH OTHER "FLATWORK".



SEWER SYSTEM CONSTRUCTION DETAILS  
STANDARD SANITARY  
SEWER SERVICE

DATE: 01/16/04

SHEET 1 OF 1

SHEET: